



ACCAM S.P.A.

EMISSIONI

REPORT LINEA 1 AGOSTO 2020						
Data	NOx	SO ₂	HCl	CO	PLV	NH ₃
	mg/Nm ³	mg/Nm ³	mg/Nm ³	mg/Nm ³	mg/Nm ³	mg/Nm ³
	media giorn.	media giorn.	media giorn.	media giorn.	media giorn.	media giorn.
1	73,5	0,3	1,82	2,4	1,08	0
2	71,9	0,6	4,71	2,3	1,12	0
3	74,5	0,6	4,65	2,8	1,13	0
4	75	0,5	4,4	3,2	1,19	0
5	71,8	0,5	4,29	2,4	1,21	0
6	70,6	0,4	4,48	2,1	1,19	0
7	71	0,5	3,95	3,6	1,19	0
8	70,4	0,6	4,24	3,4	1,22	0,02
9	66,9	0,6	4,12	3,3	1,09	0
10	66	0,6	4,22	3,5	1,16	0
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						
31						
media	71,16	0,52	4,09	2,90	1,16	0,00
Limiti	80	50	10	50	10	10





ACCAM S.P.A.

REPORT LINEA 2 AGOSTO 2020						
Data	NOx	SO ₂	HCl	CO	PLV	NH ₃
	<i>mg/Nm³</i>	<i>mg/Nm³</i>	<i>mg/Nm³</i>	<i>mg/Nm³</i>	<i>mg/Nm³</i>	<i>mg/Nm³</i>
	<i>media giorn.</i>	<i>media giorn.</i>	<i>media giorn.</i>	<i>media giorn.</i>	<i>media giorn.</i>	<i>media giorn.</i>
1						
2						
3						
4						
5						
6						
7						
8						
9						
10						
11						
12						
13						
14	63,7	2,1	4,76	6	2,34	1,33
15	63,5	2,7	4,56	3,9	1,68	1,23
16	62,9	1	4,65	4,1	1,93	1,96
17	63	0,8	4,77	3,6	1,76	1,73
18	64	1,1	5,28	4	1,4	1,23
19	62	0,8	4,83	4,7	1,24	1,14
20	60,3	0,9	4,58	4,2	1,28	1,18
21	61	1,2	5,5	4,5	1,53	1,18
22	61	1	4,76	4,7	1,35	1,38
23	64,3	1,6	5,49	4,7	1,77	1,49
24	63,6	1,1	5,24	4,3	1,2	1,57
25	67,2	1	4,71	3,7	1,2	1,64
26	66,9	1,5	5,12	3,8	1,16	1,29
27	65,3	1,4	4,15	3,4	1,09	0,72
28	68,8	1	5,19	3,3	1,24	1,48
29	71	0,8	4,63	4,2	1,27	2,36
30	66,3	0,9	4,78	4,8	1,24	1,88
31	70,3	1,8	4,51	4,1	1,13	2,84
media	64,73	1,26	4,86	4,22	1,43	1,54
Limiti	<i>80</i>	<i>50</i>	<i>10</i>	<i>50</i>	<i>10</i>	<i>10</i>



ACCAM S.P.A.

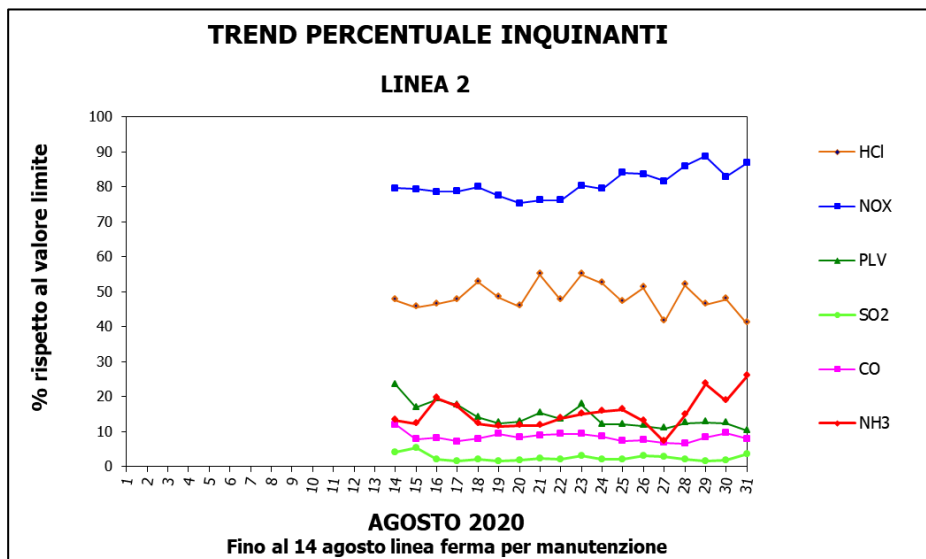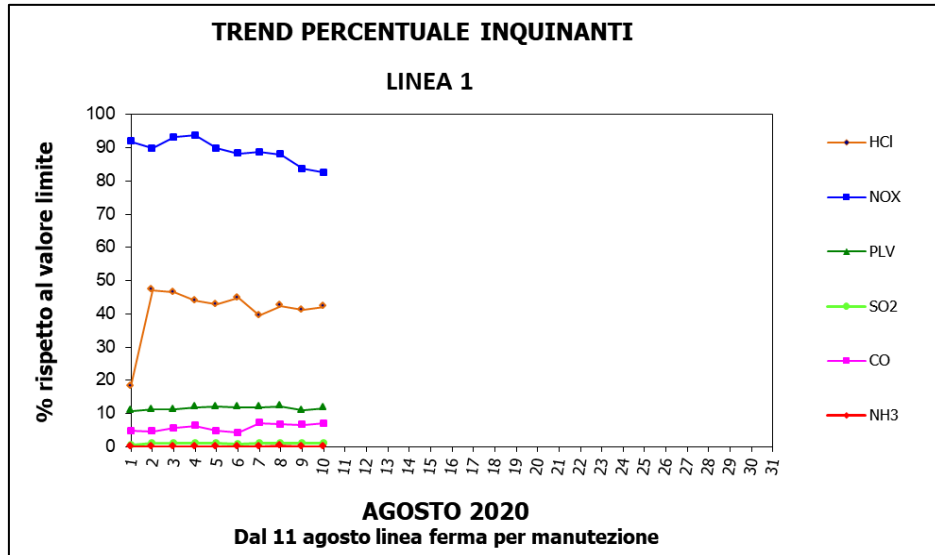

ENERGIA ELETTRICA

L'impianto ACCAM S.P.A nel mese di agosto 2020 non ha prodotto energia elettrica.